


BALDWIN®

6520 - BRISTOL SECTIONAL ESTATE HANDLESET

SPECIFICATIONS




- > Certified by Underwriters Laboratories (UL) for use on fire doors up to three-hour rating
- > U L10C / UBC 7-2 (1997) Positive Pressure Rated, UL10B Pressure Rated
- > Material: Solid Forged Brass

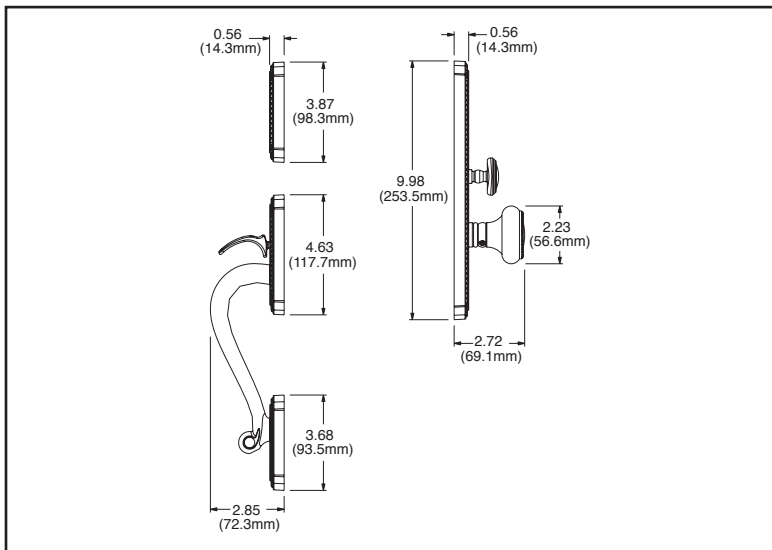

SHOWN WITH KNOB 5064



TIER 1 FINISHES

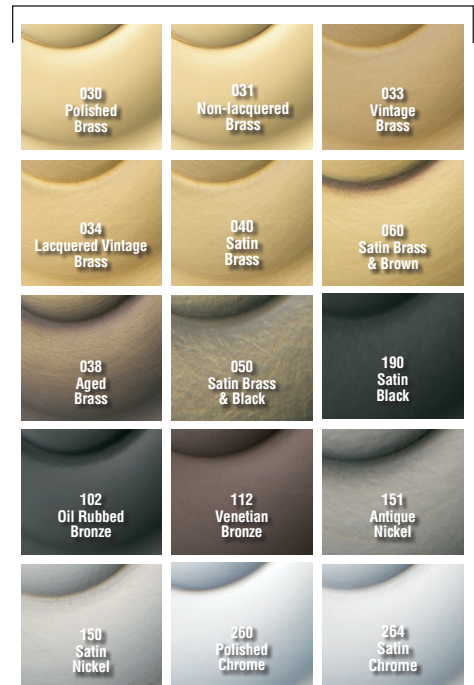

TIER 2 FINISHES

